




# Installation Instructions

CP-GL-BLK-N2 or CP-GL-SS-N2

Cover Plate with NEMA 2 Compression Gland Cable Exit

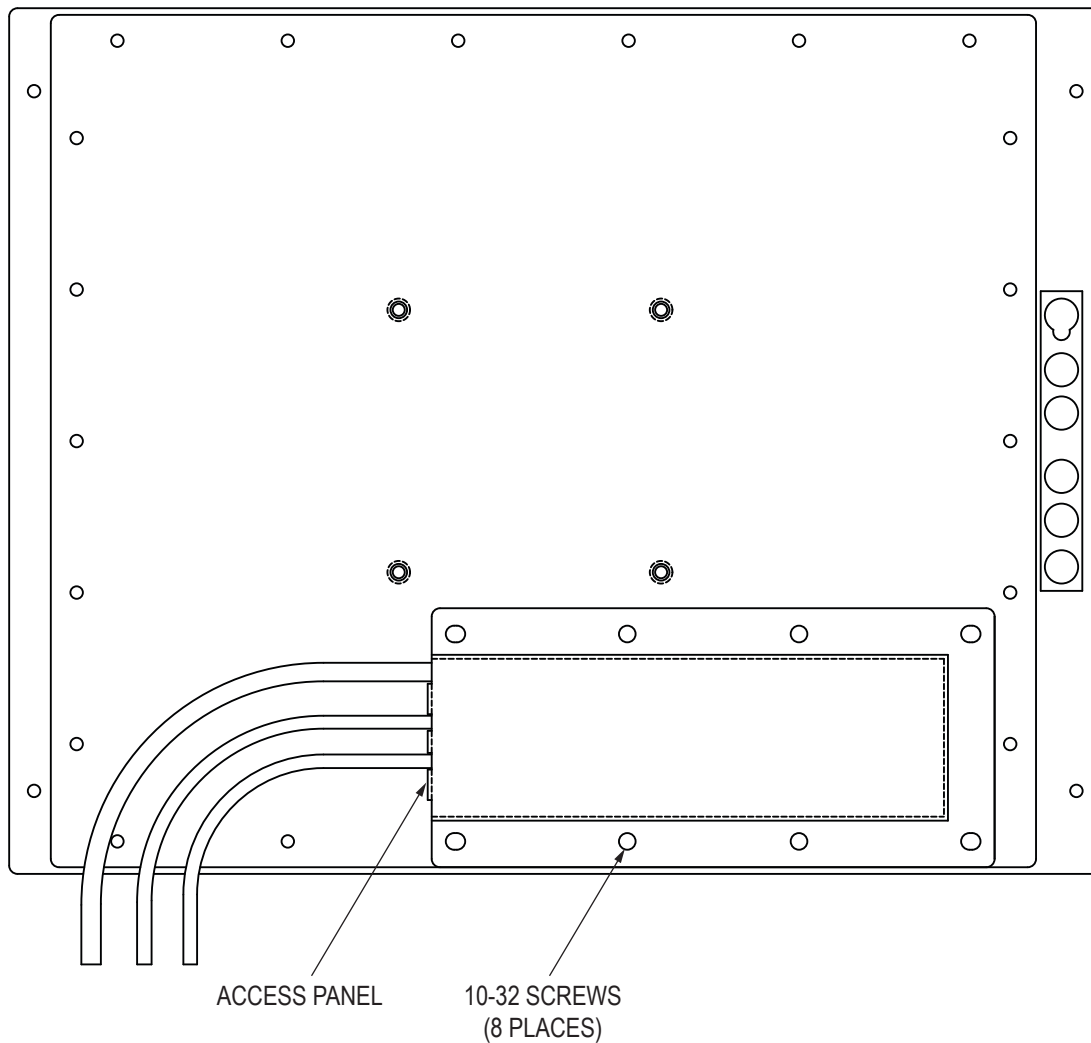

1. Route cables through access panel to the left.
2. Use the provided 10-32 screws and sealing washers. Two extra screws and washers are inside the cavity. Fully tighten all eight screws, then back off one full turn.